



## DRINKING WATER WORKS PERMIT

**Permit Number: 205-201**  
**Issue Number: 4**

Pursuant to the *Safe Drinking Water Act, 2002*, S.O. 2002, c. 32, and the regulations made thereunder and subject to the limitations thereof, I hereby issue this drinking water works permit under Part V of the *Safe Drinking Water Act, 2002*, S.O. 2002, c. 32 to:

### **The Corporation of the Town of Blind River**

**11 Hudson Street  
P.O. Box 640  
Blind River, ON  
P0R 1B0**

For the following municipal residential drinking water system:

### **Blind River Drinking Water System**

This drinking water works permit includes the following:

<b>Schedule</b>	<b>Description</b>
Schedule A	Drinking Water System Description
Schedule B	General
Schedule C	All documents issued as Schedule C to this drinking water works permit which authorize alterations to the drinking water system
Schedule D	Process Flow Diagrams

Upon the effective date of this drinking water works permit #205-201, all previously issued versions of permit #205-201 are revoked and replaced by this permit.

DATED at TORONTO this 11<sup>th</sup> day of March, 2022

Signature

A handwritten signature in black ink, appearing to read "A. Ahmed", with a horizontal line underneath it.

Aziz Ahmed, P.Eng.  
Director  
Part V, *Safe Drinking Water Act, 2002*

## Schedule A: Drinking Water System Description

System Owner	<b>The Corporation of the Town of Blind River</b>
Permit Number	<b>205-201</b>
Drinking Water System Name	<b>Blind River Drinking Water System</b>
Permit Effective Date	<b>March 11, 2022</b>

### 1.0 System Description

- 1.1 The following is a summary description of the works comprising the above drinking water system:

#### Overview

The **Blind River Drinking Water System** consists of five (5) groundwater wells and pump houses, one (1) drinking water treatment plant, two (2) storage reservoirs (clearwells), one (1) elevated storage tanks and approximately 350 meters of trunk watermains and 35 kilometers of distribution watermains.

### Groundwater Wells

#### Well No. 5

Description	Gravel packed well
Location	Located along the east shoreline of Blind River within the built-up section of the Town
UTM Coordinates	NAD27: Zone 17: Easting 349755: Northing 5116840
Dimensions	650 mm x 300 mm, depth 17.6 m
Equipment	Equipped with one (1) submersible pump capable of pumping a minimum of 6.3 L/s and a maximum of 13.24 L/s, discharging into a 400 mm common discharge header.
Notes	GUDI Well

#### Well No. 6

Description	Gravel packed well
Location	Located along the east shoreline of Blind River within the built-up section of the Town
UTM Coordinates	NAD27: Zone 17: Easting 349640: Northing 5116740
Dimensions	450 mm x 250 mm, depth 20.1 m
Equipment	Equipped with one (1) submersible pump capable of pumping a minimum of 6.3 L/s and a maximum of 13.24 L/s, discharging into a 400 mm common discharge header.
Notes	GUDI Well

**Well No. 7**

Description	Gravel packed well
Location	Located along the east shoreline of Blind River within the built-up section of the Town
UTM Coordinates	NAD27: Zone 17: Easting 349700: Northing 5116760
Dimensions	600 mm x 300 mm, depth approximately 20 m
Equipment	Equipped with one (1) submersible pump capable of pumping a minimum of 6.3 L/s and a maximum of 13.24 L/s, discharging into a 400 mm common discharge header.
Notes	GUDI Well

**Well No. 8**

Description	Naturally developed well
Location	Located along the east shoreline of Blind River within the built-up section of the Town
UTM Coordinates	NAD27: Zone 17: Easting 349875: Northing 5116980
Dimensions	200 mm diameter, casing to a depth of 21 m
Equipment	Equipped with one (1) submersible pump capable of pumping a minimum of 6.3 L/s and a maximum of 13.24 L/s, discharging into a 400 mm common discharge header.
Notes	GUDI Well

**Well No. 9**

Description	Drilled well
Location	Located along the east shoreline of Blind River within the built-up section of the Town near Riverside Drive
UTM Coordinates	NAD83: Zone: 17 Easting: 349607 Northing: 5116867
Dimensions	150 mm diameter, depth 15.24 m
Equipment	Equipped with one (1) submersible pump capable of pumping at 6.3 L/s discharging into a 100 mm pipe to the control building.
Notes	GUDI Well

## Blind River Treatment Plant

### Blind River Water Treatment Plant

Name	Blind River Water Treatment Plant
Street Address	47 Murray Street
UTM Coordinates	NAD 83: Zone 17: Easting 349593: Northing 5116383
System Type	Chemically assisted filtration and disinfection
Notes	<p>Encloses treatment process units, water storage, pumping facilities, chemical feed and storage facilities, residue management system, loading and unloading facilities, electrical and SCADA control, mechanical equipment, a standby generator set, a laboratory and operations and visitor center.</p> <p>Three parallel treatment process trains, each rated at one third of the design maximum day flow of 6,000 m<sup>3</sup>/day comprised of one in-line rapid mixer, three identical flocculation tanks, three dual media filters, three GAC contactors, de-sludging dual-media filtration and backwash facilities</p>

### Coagulation

#### In-Line Rapid Mixer

Description	One (1) in-line mechanical rapid mixer.
Dimensions	300 mm by 600 mm long
Notes	on the raw water header immediately after the coagulant injection location

### Flocculation

#### Flocculation Tank

Description	Three (3) flocculation trains, operating in parallel, each train with two (2) flocculation cells in series.
Equipment	Each cell consisting of one (1) 17.36 m <sup>3</sup> concrete tank with one (1) variable speed drive mixer.
Notes	

## Filtration

### Dual Media Filters

Description	Gravity Flow Multi-Media Filter Beds
Equipment	<p>Three (3) gravity flow multi-media filter beds with two layers, operating in parallel, each rated at one third of the design maximum day flow or 2000 m<sup>3</sup>/day with a filtration rate of approximately 7 m/hr and a hydraulic capacity of 12 m/hr with automatic backwash by air scouring and equipped with filter-to-waste ripening cycle.</p> <p>Multi-media filter beds with a surface area of each filter unit of approximately 12.25 m<sup>2</sup> consisting of top 450 mm layer of anthracite and lower 500 mm layer of Filox-R media.</p>
Notes	One (1) backwash blower capable of delivering approximately 530 SCFM.

### GAC Contactors

Description	Three (3) granular activated carbon contactors operating in parallel.
Dimensions	Each contactor unit with a surface area of approximately 12.25 m <sup>2</sup> x 1.67 m depth
Capacity	Rated at (one third of the design maximum day flow) 2,000 m <sup>3</sup> /day equipped with an automatic backwash with filtered water.
Equipment	Two (2) vertical turbine pumps (one duty one standby), each rated at 68 L/s pumping from the filtered water well.
Notes	

## Instrumentation and Control

### Continuous Monitoring/Control Equipment

Description	SCADA System
Equipment	<p>One (1) flow meter on the raw water header, high lift pump discharge header, each dual-media filtered water discharge header, each GAC contactor discharge header, GAC transfer pump discharge header and backwash water pump discharge header.</p> <p>One (1) continuous free chlorine residual analyzer with an alarm and recorder on the high lift pump discharge header.</p> <p>One (1) continuous free chlorine residual analyzer with an alarm and recorder at the outlet of the water treatment plant after secondary chlorination.</p> <p>Ultra-sonic level transmitters on the flocculated water conduit, the dual-media filters, the dual-media filtered water wells, the GAC contactors, the clearwell cells and the residue holding tank.</p> <p>One (1) continuous turbidity meter with an alarm and recorder on the raw water header, each dual-media filter discharge pipe and the water treatment plant common discharge pipe.</p> <p>One (1) continuous fluoride residual analyzer with an alarm and recorder at the discharge from the water treatment plant.</p>
Notes	

## Backwash System

Description	Backwash system for backwashing the dual-media filters and GAC contactors
Equipment	<p>Three (3) vertical turbine pumps (two duty one standby) each rated at 68 L/s at 13 m TDH.</p> <p>13.5 kW motor pumping from the filtered water well.</p>
Notes	

## Waste Residual Management

### Residue Management System

Description	Temporary holding of process wastewater, directed to municipal WWTP
Equipment	<p>One (1) residue holding tank approximately 4.6 m wide x 15.05 m long x 4.0 m SWD.</p> <p>Two (2) dry well end suction type pumps (one duty one standby), each rated at 6 L/s at 6.5 m TDH, pumping from the residue holding tank directly into the existing sanitary sewer over a 24 hour period at a uniform rate.</p>
Notes	

## High Lift Works

### High Lift Pumps

Description	Four (4) vertical turbine pumps (three duty, one standby)
Capacity	Each rated at 34 L/s at 35 m TDH capable of operating simultaneously.
Notes	

## On-Site Storage

### Dual-Media Filtered Water Well (non-chlorinated)

Description	One (1) two-celled well
Dimensions	Each cell is 6.0 m wide x 8.0 m long x 5.5 m SWD or 127 m <sup>3</sup> (total 254 m <sup>3</sup> ).
Notes	

### Clearwell Cells (chlorine contact)

Description	Two (2) four-compartment clearwell cells
Dimensions	Each with a useable volume of 243.7 m <sup>2</sup> x 5.5 m SWD or 1340.4 m <sup>3</sup> (total 2680.7 m <sup>3</sup> ).
Notes	

### Pump Wells (chlorine contact)

Description	Two (2) high lift suction well.
Dimensions	Each with a useable volume of 4.5 m wide x 6.0 m long x 5.5 m SWD or 148.5 m <sup>3</sup> (total 297 m <sup>3</sup> ).
Notes	

## Emergency Power

### Standby Power

Description	
Equipment	One (1) 300 kW prime power standby power diesel generator, water-cooled, sized to accommodate the design maximum day flow located in a separate room of the Water Treatment Plant.
	One (1) 195 kW prime power standby power diesel generator, water-cooled, sized to operate all four existing well pumps and the control facilities in order to ensure continuous raw water supply to the Water Treatment Plant located in a separate room of the Control Building.
	UPS for the water treatment plant SCADA control system.
Notes	

## Fuel Oil Systems

### Well #9 Pumphouse

Location	near Riverside Drive UTM 17 349626 E, 5116467N
Description	One (1) double walled 1,345 L fuel tank for the diesel generator
Fuel Type	Diesel
Source Protection Area	Not Applicable
Notes	

### Blind River Water Treatment Plant

Location	47 Murray Street UTM 17 349604 E, 5116854N
Description	One (1) double walled 2,270 L fuel tank for the diesel generator
Fuel Type	Diesel
Source Protection Area	Not Applicable
Notes	

## Chemical Addition

### Hydrofluosilicic Acid

Description	Fluoridation system
Feed Point	injecting into the high lift discharge header with a carrier water supply.
Equipment	One (1) 1,136 L hydrofluosilicic acid storage tank.
	Two (2) stepper motor driven positive-displacement diaphragm metering pumps, paced to finished water flow.
Notes	

### Coagulant (PACL)

Description	Coagulant and coagulant aid system
Equipment	Two (2) 2000 L PACI (coagulant) storage tanks and two (2) 200 L polymer (coagulant aid) supply drums.
	Two (2) positive displacement diaphragm metering pumps for coagulant (one duty, one standby) and one (1) polymer metering pump for coagulant aid, paced to raw water flow, injecting into the raw water header upstream of the inline rapid mixer.
Notes	Notes: Coagulant may change as a result of jar-testing and new product trials to optimize process.

### Sodium Hypochlorite

Description	Primary disinfection, pre and post chlorination as well as filter backwash
Equipment	Primary Disinfection - Two (2) common 4,000 L sodium hypochlorite storage tanks  Two (2) stepper motor driven positive-displacement diaphragm metering pumps (one duty, one standby), paced to filtered water flow, injecting into the chlorine contact chamber with a carrier water supply, prior to discharge to the pumpwell.
	Post Chlorination - Two (2) stepper motor driven positive-displacement diaphragm metering pumps (one duty, one standby), paced to finished water flow, injecting into the high lift discharge header with a carrier water supply
	Pre-chlorination (provisional) - Two (2) common 4,000 L sodium hypochlorite storage tanks  One (1) stepper motor driven positive-displacement diaphragm metering pump, paced to raw water flow, injecting into the raw water header with a carrier water supply, prior to the rapid mix chamber.
	Dual-media filter Backwash NaOCl (provisional) - Two (2) common 4,000 L sodium hypochlorite storage tanks.  One (1) stepper motor driven positive-displacement diaphragm metering pump, paced to backwash water flow, injecting into the dual-media filter backwash header with a carrier water supply.
Notes	

### Potassium Hydroxide

Description	pH adjustment system
Feed Point	filter effluent header prior to the GAC contactors.
Equipment	One (1) 1,000 L potassium hydroxide storage tank.
	Two (2) stepper motor driven positive-displacement diaphragm metering pumps, paced to filtered water flow.
Notes	

### Elevated Storage Tank

Name	The Town of Blind River Elevated Tank
Street Address	53 Queen Ave., Blind River,
UTM Coordinates	NAD83, Zone 17N, 5116530N, 349820E
System Type	Stand pipe, storage & system pressure
Notes	

### Watermains

1.1 Watermains within the distribution system comprise:

1.1.1 Watermains that have been set out in each document or file identified in column 1 of Table 1.

Table 1: Watermains	
Column 1 Document or File Name	Column 2 Date
BR QMS 06 Appendix B Blind River Water Distribution Map.pdf	May 30, 2016

1.1.2 Watermains that have been added, modified, replaced or extended further to the provisions of Schedule C of this drinking water works permit on or after the date identified in column 2 of Table 1 for each document or file identified in column 1.

1.1.3 Watermains that have been added, modified, replaced or extended further to an authorization by the Director on or after the date identified in column 2 of Table 1 for each document or file identified in column 1.

## Schedule B: General

System Owner	<b>The Corporation of the Town of Blind River</b>
Permit Number	<b>205-201</b>
Drinking Water System Name	<b>Blind River Drinking Water System</b>
Permit Effective Date	<b>March 11, 2022</b>

### 1.0 Applicability

- 1.1 In addition to any other applicable legal requirements, the drinking water system identified above shall be altered and operated in accordance with the conditions of this drinking water works permit and the licence #205-101.
- 1.2 The definitions and conditions of licence #205-101 are incorporated into this permit and also apply to this drinking water system.

### 2.0 Alterations to the Drinking Water System

- 2.1 Any document issued by the Director to be incorporated into Schedule C to this drinking water works permit shall provide authority to alter the drinking water system in accordance with the applicable conditions of this drinking water works permit and licence #205-101.
- 2.2 All documents issued by the Director as described in condition 2.1 shall form part of this drinking water works permit.
- 2.3 All parts of the drinking water system in contact with drinking water that are added, modified, replaced, extended shall be disinfected in accordance with a procedure approved by the Director or in accordance with the applicable provisions of the following documents:
  - a) Until September 9, 2022 the ministry's Watermain Disinfection Procedure, dated November 2015. As of September 10, 2022 the ministry's Watermain Disinfection Procedure, dated August 1, 2020;
  - b) Subject to condition 2.3.2, any updated version of the ministry's Watermain Disinfection Procedure;
  - c) AWWA C652 – Standard for Disinfection of Water-Storage Facilities;
  - d) AWWA C653 – Standard for Disinfection of Water Treatment Plants; and
  - e) AWWA C654 – Standard for Disinfection of Wells.
- 2.3.1 For greater clarity, where an activity has occurred that could introduce contamination, including but not limited to repair, maintenance, or physical / video inspection, all equipment that may come in contact with the drinking water system shall be disinfected in accordance with the requirements of condition 2.3. above.
- 2.3.2 Updated requirements described in condition 2.3 b) are effective six months from the date of publication of the updated Watermain Disinfection Procedure.

- 2.4 The owner shall notify the Director in writing within thirty (30) days of the placing into service or the completion of any addition, modification, replacement, removal or extension of the drinking water system which had been authorized through:
- 2.4.1 Schedule B to this drinking water works permit which would require an alteration of the description of a drinking water system component described in Schedule A of this drinking water works permit;
  - 2.4.2 Any document to be incorporated in Schedule C to this drinking water works permit respecting works other than watermains; or
  - 2.4.3 Any approval issued prior to the issue date of the first drinking water works permit respecting works other than watermains which were not in service at the time of the issuance of the first drinking water works permit.
- 2.5 The notification required in condition 2.4 shall be submitted using the "Director Notification Form" published by the Ministry.
- 2.6 For greater certainty, the notification requirements set out in condition 2.4 do not apply to any addition, modification, replacement, removal or extension in respect of the drinking water system which:
- 2.6.1 Is exempt from subsection 31(1) of the SDWA by subsection 9.(2) of O. Reg. 170/03;
  - 2.6.2 Constitutes maintenance or repair of the drinking water system; or
  - 2.6.3 Is a watermain authorized by condition 3.1 of Schedule B of this drinking water works permit.
- 2.7 The owner shall notify the legal owner of any part of the drinking water system that is prescribed as a municipal drinking water system by section 2 of O. Reg. 172/03 of the requirements of the licence and this drinking water works permit as applicable to the prescribed system.
- 2.8 For greater certainty, the owner may only carry out alterations to the drinking water system in accordance with this drinking water works permit after having satisfied other applicable legal obligations, including those arising from the *Environmental Assessment Act*, *Niagara Escarpment Planning and Development Act*, *Oak Ridges Moraine Conservation Act, 2001* and *Greenbelt Act, 2005*.

### 3.0 Watermain Additions, Modifications, Replacements and Extensions

- 3.1 The owner may alter the drinking water system, or permit it to be altered by a person acting on the owner's behalf, by adding, modifying, replacing or extending a watermain within the distribution system subject to the following conditions:
- 3.1.1 The design of the watermain addition, modification, replacement or extension:
    - a) Has been prepared by a licensed engineering practitioner;
    - b) Has been designed only to transmit water and has not been designed to treat water;

- c) Satisfies the design criteria set out in the Ministry publication "Watermain Design Criteria for Future Alterations Authorized under a Drinking Water Works Permit – June 2012", as amended from time to time; and
  - d) Is consistent with or otherwise addresses the design objectives contained within the Ministry publication "Design Guidelines for Drinking Water Systems, 2008", as amended from time to time.
- 3.1.2 The maximum demand for water exerted by consumers who are serviced by the addition, modification, replacement or extension of the watermain will not result in an exceedance of the rated capacity of a treatment subsystem or the maximum flow rate for a treatment subsystem component as specified in the licence, or the creation of adverse conditions within the drinking water system.
- 3.1.3 The watermain addition, modification, replacement or extension will not adversely affect the distribution system's ability to maintain a minimum pressure of 140 kPa at ground level at all points in the distribution system under maximum day demand plus fire flow conditions.
- 3.1.4 Secondary disinfection will be provided to water within the added, modified, replaced or extended watermain to meet the requirements of O. Reg. 170/03.
- 3.1.5 The watermain addition, modification, replacement or extension is wholly located within the municipal boundary over which the owner has jurisdiction.
- 3.1.6 The owner of the drinking water system consents in writing to the watermain addition, modification, replacement or extension.
- 3.1.7 A licensed engineering practitioner has verified in writing that the watermain addition, modification, replacement or extension meets the requirements of condition 3.1.1.
- 3.1.8 The owner of the drinking water system has verified in writing that the watermain addition, modification, replacement or extension meets the requirements of conditions 3.1.2 to 3.1.6.
- 3.2 The authorization for the addition, modification, replacement or extension of a watermain provided for in condition 3.1 does not include the addition, modification, replacement or extension of a watermain that:
- 3.2.1 Passes under or through a body of surface water, unless trenchless construction methods are used;
  - 3.2.2 Has a nominal diameter greater than 750 mm;
  - 3.2.3 Results in the fragmentation of the drinking water system; or
  - 3.2.4 Connects to another drinking water system, unless:
    - a) Prior to construction, the owner of the drinking water system seeking the connection obtains written consent from the owner or owner's delegate of the drinking water system being connected to; and

- b) The owner of the drinking water system seeking the connection retains a copy of the written consent from the owner or owner's delegate of the drinking water system being connected to as part of the record that is recorded and retained under condition 3.3.
- 3.3 The verifications required in conditions 3.1.7 and 3.1.8 shall be:
- 3.3.1 Recorded on "Form 1 – Record of Watermains Authorized as a Future Alteration", as published by the Ministry, prior to the watermain addition, modification, replacement or extension being placed into service; and
- 3.3.2 Retained for a period of ten (10) years by the owner.
- 3.4 For greater certainty, the verification requirements set out in condition 3.3 do not apply to any addition, modification, replacement or extension in respect of the drinking water system which:
- 3.4.1 Is exempt from subsection 31(1) of the SDWA by subsection 9.(2) of O. Reg. 170/03; or
- 3.4.2 Constitutes maintenance or repair of the drinking water system.
- 3.5 The document or file referenced in Column 1 of Table 1 of Schedule A of this drinking water works permit that sets out watermains shall be retained by the owner and shall be updated to include watermain additions, modifications, replacements and extensions within 12 months of the addition, modification, replacement or extension.
- 3.6 The updates required by condition 3.5 shall include watermain location relative to named streets or easements and watermain diameter.
- 3.7 Despite clause (a) of condition 3.1.1 and condition 3.1.7, with respect to the replacement of an existing watermain or section of watermain that is 6.1 meters in length or less, if a licensed engineering practitioner has:
- 3.7.1 inspected the replacement prior to it being put into service;
- 3.7.2 prepared a report confirming that the replacement satisfies clauses (b), (c) and (d) of condition 3.1.1 (i.e. "Form 1 – Record of Watermains Authorized by a Future Alteration" (Form 1), Part 3, items No. 2, 3 and 4); and
- 3.7.3 appended the report referred to in condition 3.7.2 to the completed Form 1, the replacement is exempt from the requirements that the design of the replacement be prepared by a licensed engineering practitioner and that a licensed engineering practitioner verify on Form 1, Part 3, item No. 1 that a licensed engineering practitioner prepared the design of the replacement.
- 3.8 For greater certainty, the exemption in condition 3.7 does not apply to the replacement of an existing watermain or section of watermain if two or more sections of pipe, each of which is 6.1 meters in length or less, are joined together, if the total length of replacement pipes joined together is greater than 6.1 meters.

## 4.0 Minor Modifications to the Drinking Water System

4.1 The drinking water system may be altered by adding, modifying or replacing the following components in the drinking water system:

4.1.1 Coagulant feed systems in the treatment system, including the location and number of dosing points:

- a) Prior to making any alteration to the drinking water system under condition 4.1.1, the owner shall undertake a review of the impacts that the alteration might have on corrosion control or other treatment processes; and
- b) The owner shall notify the Director in writing within thirty (30) days of any alteration made under condition 4.1.1 and shall provide the Director with a copy of the review.
- c) The notification required in condition 4.1.1 b) shall be submitted using the "Director Notification Form" published by the Ministry

4.1.2 Instrumentation and controls, including new SCADA systems and upgrades to SCADA system hardware;

4.1.3 SCADA system software or programming that:

- a) Measures, monitors or reports on a regulated parameter;
- b) Measures, monitor or reports on a parameter that is used to calculate CT; or,
- c) Calculates CT for the system or is part of the process algorithm that calculates log removal, where the impacts of addition, modification or replacement have been reviewed by a licensed engineering practitioner;

4.1.4 Filter media, backwashing equipment, filter troughs, and under-drains and associated equipment in the treatment system;

4.1.5 Spill containment works; or,

4.1.6 Coarse screens and fine screens

4.2 The drinking water system may be altered by adding, modifying, replacing or removing the following components in the drinking water system:

4.2.1 Treated water pumps, pressure tanks, and associated equipment;

4.2.2 Raw water pumps and process pumps in the treatment system;

4.2.3 Inline booster pumping stations that are not associated with distribution system storage facilities and are on a watermain with a nominal diameter not exceeding 200 mm;

4.2.4 Re-circulation devices within distribution system storage facilities;

4.2.5 In-line mixing equipment;

- 4.2.6 Chemical metering pumps and chemical handling pumps;
  - 4.2.7 Chemical storage tanks (excluding fuel storage tanks) and associated equipment; or,
  - 4.2.8 Measuring and monitoring devices that are not required by regulation, by a condition in the Drinking Water Works Permit, or by a condition otherwise imposed by the Ministry.
  - 4.2.9 Chemical injection points;
  - 4.2.10 Valves.
- 4.3 The drinking water system may be altered by replacing the following:
- 4.3.1 Raw water piping, treatment process piping or treated water piping within the treatment subsystem;
  - 4.3.2 Measuring and monitoring devices that are required by regulation, by a condition in the Drinking Water Works Permit or by a condition otherwise imposed by the Ministry.
  - 4.3.3 Coagulants and pH adjustment chemicals, where the replacement chemicals perform the same function;
    - a) Prior to making any alteration to the drinking water system under condition 4.3.3, the owner shall undertake a review of the impacts that the alteration might have on corrosion control or other treatment processes; and
    - b) The owner shall notify the Director in writing within thirty (30) days of any alteration made under condition 4.3.3 and shall provide the Director with a copy of the review.
    - c) The notification required in condition 4.3.3 b) shall be submitted using the "Director Notification Form" published by the Ministry.
- 4.4 Any alteration of the drinking water system made under conditions 4.1, 4.2 or 4.3 shall not result in:
- 4.4.1 An exceedance of a treatment subsystem rated capacity or a treatment subsystem component maximum flow rate as specified in the licence;
  - 4.4.2 The bypassing or removal of any unit process within a treatment subsystem;
  - 4.4.3 The addition of any new unit process other than coagulation within a treatment subsystem;
  - 4.4.4 A deterioration in the quality of drinking water provided to consumers;
  - 4.4.5 A reduction in the reliability or redundancy of any component of the drinking water system;

- 4.4.6 A negative impact on the ability to undertake compliance and other monitoring necessary for the operation of the drinking water system; or
  - 4.4.7 An adverse effect on the environment.
- 4.5 The owner shall verify in writing that any addition, modification, replacement or removal of drinking water system components in accordance with conditions 4.1, 4.2 or 4.3 has met the requirements of the conditions listed in condition 4.4.
- 4.6 The verifications and documentation required in condition 4.5 shall be:
- 4.6.1 Recorded on "Form 2 – Record of Minor Modifications or Replacements to the Drinking Water System" published by the Ministry, prior to the modified or replaced components being placed into service; and
  - 4.6.2 Retained for a period of ten (10) years by the owner.
- 4.7 For greater certainty, the verification requirements set out in conditions 4.5 and 4.6 do not apply to any addition, modification, replacement or removal in respect of the drinking water system which:
- 4.7.1 Is exempt from subsection 31(1) of the SDWA by subsection 9.(2) of O. Reg. 170/03; or
  - 4.7.2 Constitutes maintenance or repair of the drinking water system, including software changes to a SCADA system that are not listed in condition 4.1.3
- 4.8 The owner shall update any drawings maintained for the drinking water system to reflect the modification or replacement of the works, where applicable.

## 5.0 Equipment with Emissions to the Air

- 5.1 The drinking water system may be altered by adding, modifying or replacing any of the following drinking water system components that may discharge or alter the rate or manner of a discharge of a compound of concern to the air:
- 5.1.1 Any equipment, apparatus, mechanism or thing that is used for the transfer of outdoor air into a building or structure that is not a cooling tower;
  - 5.1.2 Any equipment, apparatus, mechanism or thing that is used for the transfer of indoor air out of a space used for the production, processing, repair, maintenance or storage of goods or materials, including chemical storage;
  - 5.1.3 Laboratory fume hoods used for drinking water testing, quality control and quality assurance purposes;
  - 5.1.4 Low temperature handling of compounds with a vapor pressure of less than 1 kilopascal;
  - 5.1.5 Maintenance welding stations;
  - 5.1.6 Minor painting operations used for maintenance purposes;

- 5.1.7 Parts washers for maintenance shops;
  - 5.1.8 Emergency chlorine and ammonia gas scrubbers and absorbers;
  - 5.1.9 Venting for activated carbon units for drinking water taste and odour control;
  - 5.1.10 Venting for a stripping unit for methane removal from a groundwater supply;
  - 5.1.11 Venting for an ozone treatment unit;
  - 5.1.12 Natural gas or propane fired boilers, water heaters, space heaters and make-up air units with a total facility-wide heat input rating of less than 20 million kilojoules per hour, and with an individual fuel energy input of less than or equal to 10.5 gigajoules per hour; or
  - 5.1.13 Emergency generators that fire No. 2 fuel oil (diesel fuel) with a sulphur content of 0.5 per cent or less measured by weight, natural gas, propane, gasoline or biofuel, and that are used for emergency duty only with periodic testing.
- 5.2 The owner shall not make an addition, modification, or replacement described in condition 5.1 in relation to an activity that is not related to the treatment and/or distribution of drinking water.
- 5.3 The emergency generators identified in condition 5.1.13 shall not be used for non-emergency purposes including the generation of electricity for sale or for peak shaving purposes.
- 5.4 The owner shall prepare an emission summary table for nitrogen oxides emissions only, for each addition, modification or replacement of emergency generators identified in condition 5.1.13.

#### Performance Limits

- 5.5 The owner shall ensure that a drinking water system component identified in conditions 5.1.1 to 5.1.13 is operated at all times to comply with the following limits:
- 5.5.1 For equipment other than emergency generators, the maximum concentration of any compound of concern at a point of impingement shall not exceed the corresponding point of impingement limit;
  - 5.5.2 For emergency generators, the maximum concentration of nitrogen oxides at sensitive receptors shall not exceed the applicable point of impingement limit, and at non-sensitive receptors shall not exceed the Ministry half-hourly screening level of 1880 ug/m<sup>3</sup> as amended; and
  - 5.5.3 The noise emissions comply at all times with the limits set out in publication NPC-300, as applicable.
- 5.6 The owner shall verify in writing that any addition, modification or replacement of works in accordance with condition 5.1 has met the requirements of the conditions listed in condition 5.5.

- 
- 5.7 The owner shall document how compliance with the performance limits outlined in condition 5.5.3 is being achieved, through noise abatement equipment and/or operational procedures.
  - 5.8 The verifications and documentation required in conditions 5.6 and 5.7 shall be:
    - 5.8.1 Recorded on "Form 3 – Record of Addition, Modification or Replacement of Equipment Discharging a Contaminant of Concern to the Atmosphere", as published by the Ministry, prior to the additional, modified or replacement equipment being placed into service; and
    - 5.8.2 Retained for a period of ten (10) years by the owner.
  - 5.9 For greater certainty, the verification and documentation requirements set out in conditions 5.6 and 5.8 do not apply to any addition, modification or replacement in respect of the drinking water system which:
    - 5.9.1 Is exempt from subsection 31(1) of the SDWA by subsection 9.(2) of O. Reg. 170/03; or
    - 5.9.2 Constitutes maintenance or repair of the drinking water system.
  - 5.10 The owner shall update any drawings maintained for the works to reflect the addition, modification or replacement of the works, where applicable.

## 6.0 Previously Approved Works

- 6.1 The owner may add, modify, replace or extend, and operate part of a municipal drinking water system if:
  - 6.1.1 An approval was issued after January 1, 2004 under section 36 of the SDWA in respect of the addition, modification, replacement or extension and operation of that part of the municipal drinking water system;
  - 6.1.2 The approval expired by virtue of subsection 36(4) of the SDWA; and
  - 6.1.3 The addition, modification, replacement or extension commenced within five years of the date that activity was approved by the expired approval.

## 7.0 System-Specific Conditions

- 7.1 Not Applicable

## 8.0 Source Protection

- 8.1 Not Applicable

## Schedule C: Authorization to Alter the Drinking Water System

System Owner	The Corporation of the Town of Blind River
Permit Number	205-201
Drinking Water System Name	Blind River Drinking Water System
Permit Effective Date	March 11, 2022

### 1.0 General

1.1 Table 2 provides a reference list of all documents to be incorporated into Schedule C that have been issued as of the date that this permit was issued.

1.1.1 Table 2 is not intended to be a comprehensive list of all documents that are part of Schedule C. For clarity, any document issued by the Director to be incorporated into Schedule C after this permit has been issued is considered part of this drinking water works permit.

**Table 2: Schedule C Documents**

Column 1 Issue #	Column 2 Issued Date	Column 3 Description	Column 4 Status	Column 5 DN#
1	January 7, 2013	Decommission Well 4 and 4A, commission Well 9	Archived	1


1.2 For each document described in columns 1, 2 and 3 of Table 2, the status of the document is indicated in column 4. Where this status is listed as 'Archived', the approved alterations have been completed and relevant portions of this permit have been updated to reflect the altered works. These 'Archived' Schedule C documents remain as a record of the alterations.

## Schedule D: Process Flow Diagrams

System Owner	The Corporation of the Town of Blind River
Permit Number	205-201
Drinking Water System Name	Blind River Drinking Water System
Permit Effective Date	March 11, 2022

### 1.0 Process Flow Diagrams

#### Blind River Water Treatment Plant

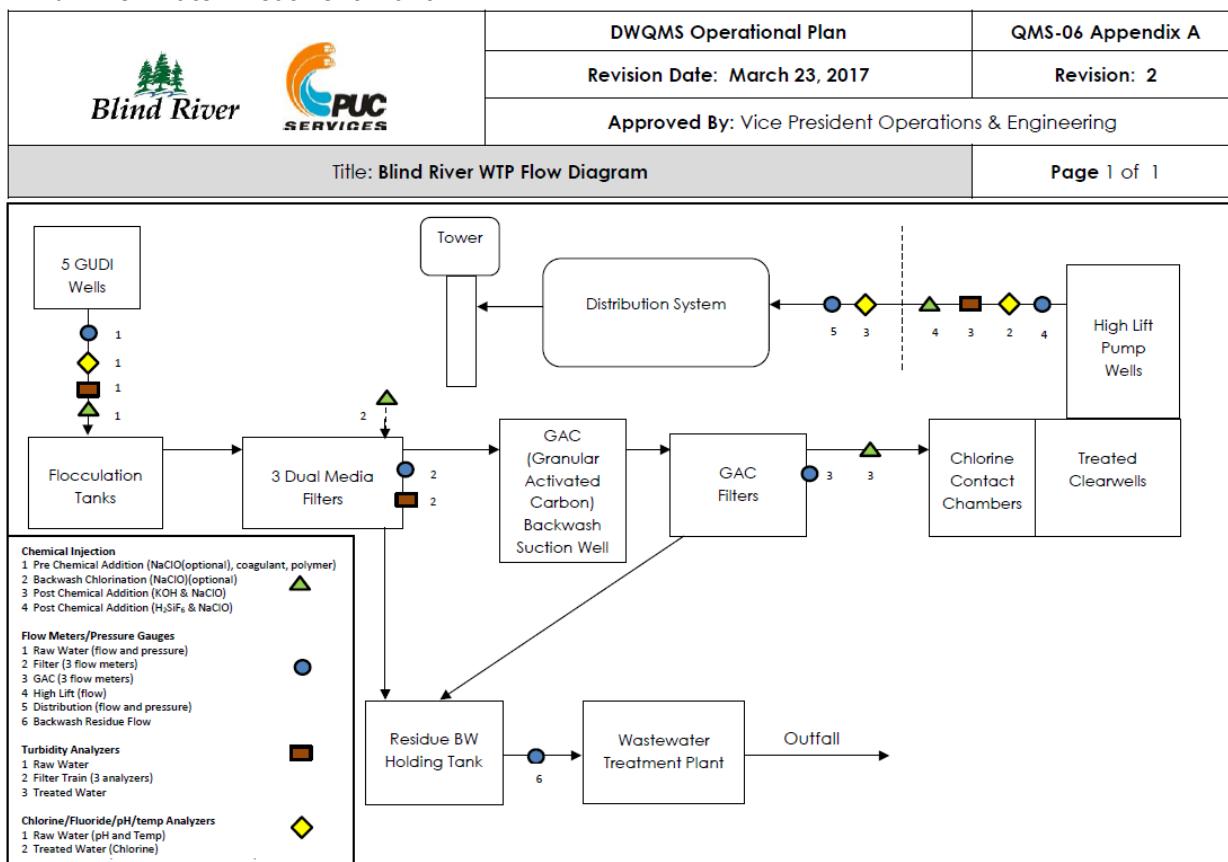

- The Town of Blind River DWQMS Operational Plan -

BR QMS 06 Appendix A Blind River WTP Flow Diagram

Reviewed Date: March 23, 2017

**[Source: Blind River Drinking Water System DWQMS Operation Plan Number 205-401, QMS-06 Appendix A, Revision Date: March 23, 2017]**

**Note: this process flow diagram is for reference only, and represents a high level overview of the system as of March 23, 2017.**